


REVISIONS			
REV.	DESCRIPTION	DATE	APPD.

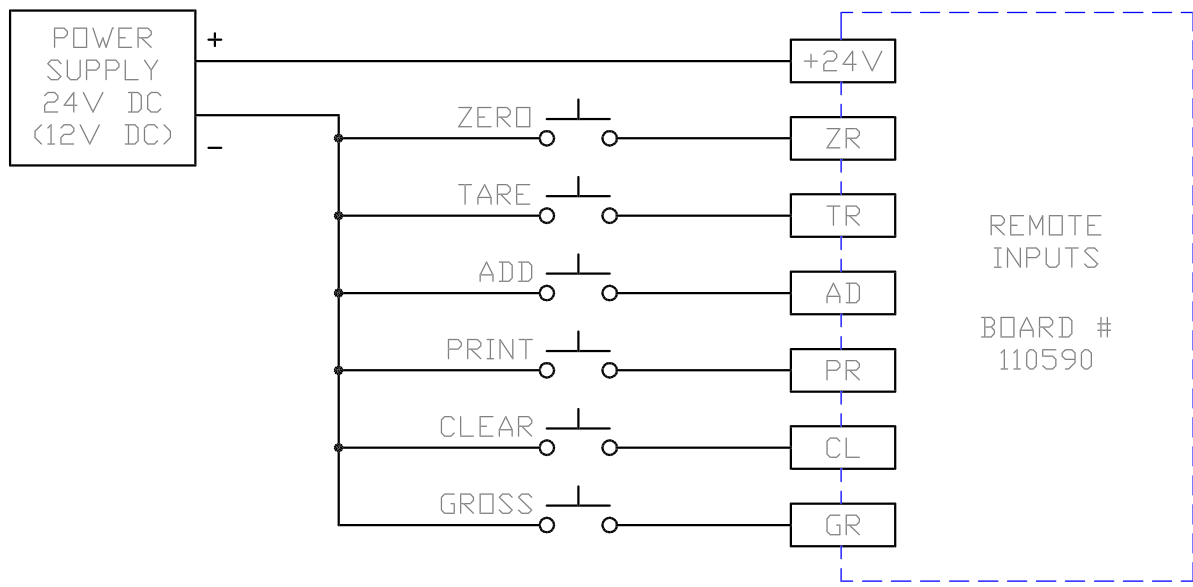

NOTES: UNLESS OTHERWISE SPECIFIED

1. INPUTS ARE OPTICALLY ISOLATED FROM INDICATOR GROUND.

2. EACH INPUT REQUIRES A SUPPLY CURRENT OF 10mA (5mA FOR 12V).

TOL.	.X±	.XX±	.XXX±	ANG.±	DATE	96-09-12	DRAWN	P. MUELLER	CUSTOMER		SHEET
DO NOT SCALE DRAWING					SCALE	NTS	DESIGNED		JOB NO.		1 OF 1
WESTERN SCALE COMPANY LIMITED PORT COQUITLAM, B.C., CANADA								CHECKED	REMOTE INPUTS - TYPICAL WIRING		REV.
								APPROVED			--
									SIZE	DRAWING NUMBER	
									A	111154	